





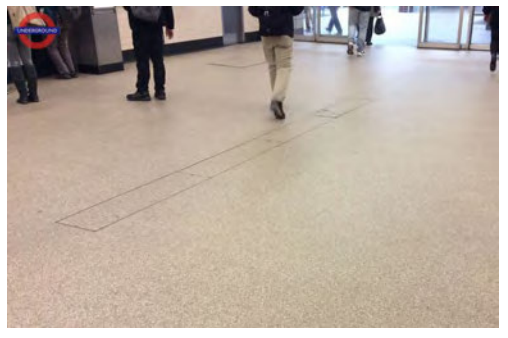


ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24442	
Description:	Asbestos: No Access: Presumed D229-00: Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Void	
Comments:	Entrance Exterior - Above Entrance Canopies - No Access	
Reference:	24443	
Description:	Asbestos: Strongly Presumed D229-00: Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Glazing Rope	
Comments:	Stairs Entrance Exterior - Potential Chrysotile gaskets within Glazing Rope	
Reference:	45281	
Description:	Asbestos: Known D229-00-1/001: Booking Hall - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable Sheath	
Comments:	Cable pit by waiting area adjacent to shop 1/451 - 2x white braided cables (within 3 no walls?)	

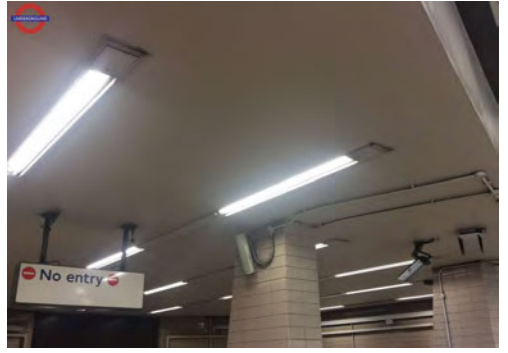
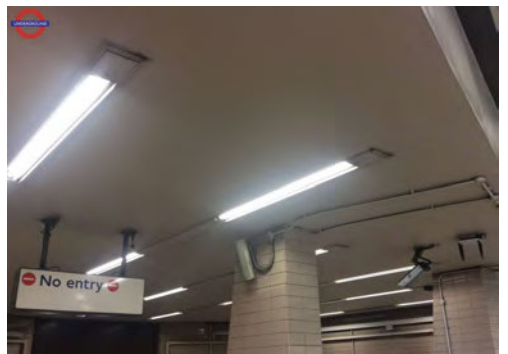

ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24445	
Description:	Asbestos: No Access: Presumed D229-00-1/001/CLG-01: Ceiling: Suspended - 1 - Booking Hall - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Void	
Comments:	Void above false ceiling	
Reference:	24444	
Description:	Asbestos: No Access: Presumed D229-00-1/001/FLR-01: Floor - 1 - Booking Hall - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Void	
Comments:	No Access beneath Inspection Chambers to Floor For Cable Pit adjacent to 1/451 see 45281	
Reference:	25278	
Description:	Asbestos: No Access: Presumed D229-00-1/201/CLG-01: Ceiling: Solid - 1 - Circulation Area - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Void	
Comments:	No Access above Plasterboard Ceiling	
Reference:	24520	
Description:	Asbestos: No Access: Presumed D229-00-1/451/CLG-01: Ceiling: Suspended - 1 - Tenancy - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Void	
Comments:	No Access above false ceiling NB Tenancy Managed by TFL Commercial Properties	




ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24523	
Description:	Asbestos: No Access: Presumed D229-00-1/602/CLG-01: Ceiling: Suspended - 1 - Linear Stairs - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Void	
Comments:	No Access above Plasterboard Ceiling	
Reference:	24525	
Description:	Asbestos: No Access: Presumed D229-00-1/603/CLG-01: Ceiling: Suspended - 1 - Linear Stairs - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Void	
Comments:	No access above Plasterboard ceiling	
Reference:	45283	
Description:	Asbestos: Known D229-00-1/661: Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Cable Pit - 2x White braided cables running from external wall (bus stop side) along walls (loose to floor) and into electrical main sector box	

ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	45282	
Description:	Asbestos: Known D229-00-1/661: Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable Ducts: Bitumen	
Comments:	Cable Pit - 8x cable ducts to external wall(bus stop side) in cable pit	
Reference:	25286	
Description:	Asbestos: Presumed D229-00-1/661/WAL-001: Wall: Internal - 1 - Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Other Electrical Boxes	
Comments:	1 x Transformer Boxes No electrician on site during 2020 re-inspection to open boxes for inspection - therefore cannot score material within.	
Reference:	24529	
Description:	Asbestos: Presumed D229-00-1/661/WAL-001: Wall: Internal - 1 - Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Isolator Switches	
Comments:	1x 60amp Combination switch box	

ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24530	
Description:	Asbestos: Presumed D229-00-1/661/WAL-002: Wall: Internal - 2 - Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Other Electrical Boxes	
Comments:	3 x Transformer Boxes	
Reference:	24228	
Description:	Asbestos: Presumed D229-00-1/661/WAL-002: Wall: Internal - 2 - Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Isolator Switches	
Comments:	1x 30amp Combination switch box	
Reference:	24527	
Description:	Asbestos: Known D229-00-1/661/WAL-003: Wall: Internal - 3 - Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable Ducts: Cement	
Comments:	2 x 6"x6" cement pads below electric meter	

ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24528	
Description:	Asbestos: Known D229-00-1/661/WAL-003: Wall: Internal - 3 - Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	60mm x 2 woven sheath cables - Exit: main switch board, right hand side of door	
Reference:	44283	
Description:	Asbestos: Presumed D229-00-1/761/WAL-004: Wall: Internal - 4 - Plant Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Control Panels	
Comments:	Control panel 1 no to wall 4	
Reference:	45284	
Description:	Asbestos: Known D229-00-1/781: Substation Room - Substation - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Property managed by LU Power & Electrical - 2x 70m white braided cables within wall (shop side) labelled and encapsulated within incorez. (cables only encapsulated substation side and not in any cable pit	

ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	45285	
Description:	Asbestos: Known D229-00-1/781: Substation Room - Substation - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable Ducts: Bitumen	
Comments:	Property managed by LU Power & Electrical - 10x Bitumen cable ducts within wall (shop side)	
Reference:	24602	
Description:	Asbestos: Presumed D229-00-1/902/WAL-004: Wall: Internal - 4 - Office - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Isolator Switches	
Comments:	1x 30amp Switch Box - Insulation within	
Reference:	24611	
Description:	Asbestos: Known D229-00-2/081: Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	8x15mm cable - entry from invert, exit - LHS of relay room into relay room, j hanger no. 1	



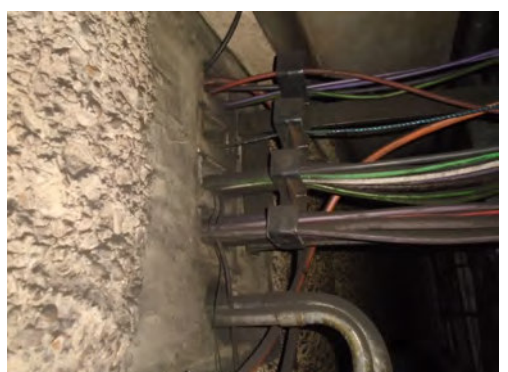
ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24615	
Description:	Asbestos: Known D229-00-2/081: Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	3x15mm cable entry from invert, exit LHS of relay room into relay room, j hanger no. 4	
Reference:	24621	
Description:	Asbestos: Known D229-00-2/081: Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	1 x 15mm cable entry via invert runs along RHS relay room - j hanger no. 4	
Reference:	24620	
Description:	Asbestos: Known D229-00-2/081: Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	1 x 20mm cable entry via invert runs along RHS relay room - j hanger no. 3`	


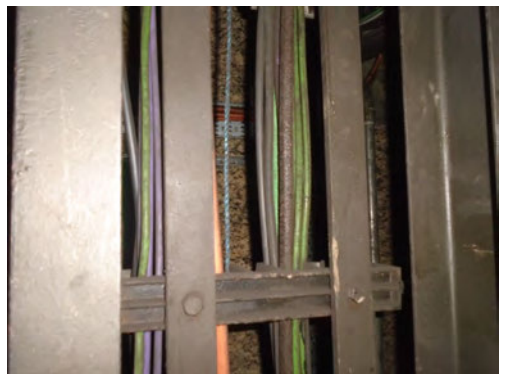

ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24618	
Description:	Asbestos: Known D229-00-2/081: Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	10 x 15mm cable entry via invert runs along RHS relay room - j hanger no. 1	
Reference:	24612	
Description:	Asbestos: Known D229-00-2/081: Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	4x30mm cable, entry from invert - exit: LHS of relay room into relay room, j hanger no. 2	
Reference:	24613	
Description:	Asbestos: Known D229-00-2/081: Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	2x15mm cable - entry from invert, exit LHS of relay room into relay room, j hanger no. 3	




ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24614	
Description:	Asbestos: Known D229-00-2/081: Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	1x 30mm cable entry from invert, exit LHS of relay room into relay room, j hanger no. 3	
Reference:	24608	
Description:	Asbestos: Known D229-00-2/081: Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	2x15mm Cable	
Reference:	24619	
Description:	Asbestos: Known D229-00-2/081: Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	3x15mm cable entry via invert runs along RHS relay room - j hanger no. 3	



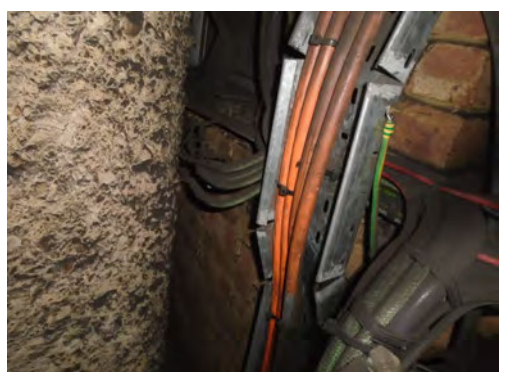
ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24605	
Description:	Asbestos: Presumed D229-00-2/081/WAL-001: Wall: Internal - 1 - Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Westing house Boxes	
Comments:	1 x Westinghouse Box - Insulation within	
Reference:	24610	
Description:	Asbestos: Known D229-00-2/081/WAL-002: Wall: Internal - 2 - Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	1 x15mm cable - enters room via platform signal box wall 2 - drops into invert	
Reference:	24609	
Description:	Asbestos: Known D229-00-2/081/WAL-003: Wall: Internal - 3 - Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	1x20mm cable enters room via invert to high level, exits through concrete ducts to wall 3 to trackside	

ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24617	
Description:	Asbestos: Known D229-00-2/081/WAL-005: Wall: Internal - 5 - Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	1x20mm cable entry through invert to high level, exit through concrete duct wall 5 to trackside	
Reference:	25373	
Description:	Asbestos: Known D229-00-2/081/WAL-005: Wall: Internal - 5 - Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	4x15mm cable entry through invert to high level, exit through concrete duct wall 5 to trackside	
Reference:	24616	
Description:	Asbestos: Known D229-00-2/081/WAL-006: Wall: Internal - 6 - Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	4x15mm Cable entry through invert up wall 6 - cable cut redundant	

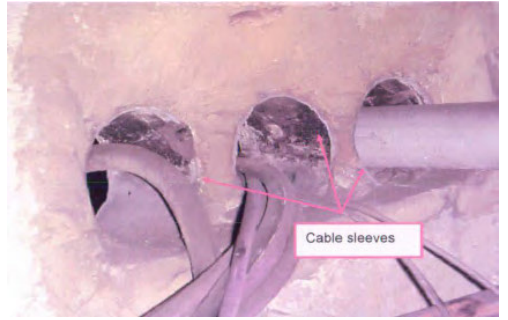

ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24606	
Description:	Asbestos: Presumed D229-00-2/081/WAL-007: Wall: Internal - 7 - Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Westing house Boxes	
Comments:	2 x Westinghouse Box - Insulation within	
Reference:	24607	
Description:	Asbestos: Known D229-00-2/081/WAL-007: Wall: Internal - 7 - Lobby - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	10mm cable -from westinghouse boxes into invert	
Reference:	24691	
Description:	Asbestos: Known D229-00-2/261: Platform 1 - Westbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Platform 1 Invert - 2 x cut braided cables	




ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24689	
Description:	Asbestos: Known D229-00-2/261: Platform 1 - Westbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Platform 1 Invert - 30 x cable sleeves - Chrysotile (including 6 x cable ducts departure end head wall - R202651)	
Reference:	24688	
Description:	Asbestos: Strongly Presumed D229-00-2/261: Platform 1 - Westbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Gasket :Pipework	
Comments:	Concourse Invert (hatch near 2/081) - 7 x gaskets - 7m from entrance	
Reference:	24690	
Description:	Asbestos: Strongly Presumed D229-00-2/261: Platform 1 - Westbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Platform 1 Invert - 28 x braided cables - throughout invert	
Reference:	24695	
Description:	Asbestos: Presumed D229-00-2/261: Platform 1 - Westbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Other Electrical Boxes	
Comments:	Platform 1 Invert - possible ACM inside 2 electrical boxes on the track wall	

ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24693	
Description:	Asbestos: Strongly Presumed D229-00-2/261: Platform 1 - Westbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Platform 1 Invert - 1x Braided cable - trackside wall on 3rd from top j hanger	
Reference:	24694	
Description:	Asbestos: Strongly Presumed D229-00-2/261: Platform 1 - Westbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Platform 1 Invert - 5x Braided cables on platform side wall - green and white cables	
Reference:	24687	
Description:	Asbestos: Strongly Presumed D229-00-2/261: Platform 1 - Westbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable Duct: Other	
Comments:	Concourse Invert (hatch near 2/081) - 1 x cable sleeve filled in - 6m from entrance	
Reference:	24625	
Description:	Asbestos: Strongly Presumed D229-00-2/261/CLG-01: Ceiling: Suspended - 1 - Platform 1 - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	2 x braided cables in access hatch	

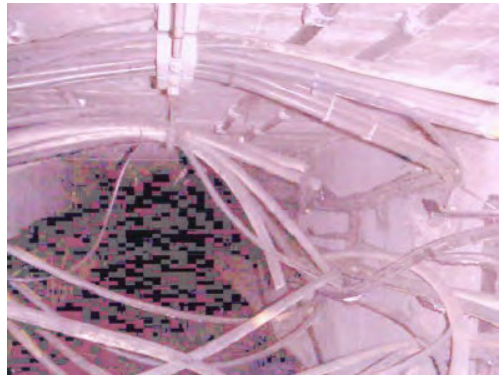


ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24701	
Description:	Asbestos: Presumed D229-00-2/262: Platform 2 - Eastbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Platform 2 Invert - Cut Cables 3 x 14m, 15m & 25m from entrance	
Reference:	24700	
Description:	Asbestos: Strongly Presumed D229-00-2/262: Platform 2 - Eastbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Platform 2 Invert - 16 x braided cables throughout invert	
Reference:	24698	
Description:	Asbestos: Presumed D229-00-2/262: Platform 2 - Eastbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Other Electrical Boxes	
Comments:	Platform 2 - Concourse Invert (hatch near 2/081) - 3 x Fuse Boxes - Insulation within - 10m from Hatch	




ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24702	
Description:	Asbestos: Strongly Presumed D229-00-2/262: Platform 2 - Eastbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	4 x braided cables - crossing invert	
Reference:	24699	
Description:	Asbestos: Known D229-00-2/262: Platform 2 - Eastbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable Duct: Other	
Comments:	Platform 2 - Invert 6 x cable sleeves - Head wall - Chrysotile	
Reference:	24416	
Description:	Asbestos: Presumed D229-00-2/262: Platform 2 - Eastbound Local - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Westing house Boxes	
Comments:	Components within 2 x Small Westinghouse boxes	




ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	44288	
Description:	Asbestos: Presumed D229-00-2/331/CLG-01: Ceiling: Solid - 1 - Mess Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Control Panels	
Comments:	Control panel 1 no to wall 2 behind locker	
Reference:	44290	
Description:	Asbestos: Presumed D229-00-2/414: Yard - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Control Panels	
Comments:	Fan Control panel 1 no to low wall in front of metal platform	
Reference:	25382	
Description:	Asbestos: Strongly Presumed D229-00-2/414: Yard - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Cable Run WB - 7 x braided cables	




ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24711	
Description:	Asbestos: Strongly Presumed D229-00-2/414: Yard - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Westing house Boxes	
Comments:	Wall by Invert EB side - Westinghouse Box & 2 x Green 40mmØ Cables	
Reference:	24796	
Description:	Asbestos: Strongly Presumed D229-00-2/414: Yard - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Rope Seals	
Comments:	Trackside Wall WB - 4 x Westinghouse Boxes	
Reference:	24795	
Description:	Asbestos: Strongly Presumed D229-00-2/414: Yard - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Trackside Wall WB - 2 x braided cables	

ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24714	
Description:	Asbestos: Strongly Presumed D229-00-2/414: Yard - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	Cable Run EB - 14 x cables	
Reference:	24713	
Description:	Asbestos: Strongly Presumed D229-00-2/414: Yard - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable Duct: Other	
Comments:	Wall to Invert WB side - 6 x cable sleeves in each - Encapsulated - no access	
Reference:	24712	
Description:	Asbestos: Strongly Presumed D229-00-2/414: Yard - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable Duct: Other	
Comments:	Wall to Invert EB side - 6 x cable sleeves in each - Encapsulated - no access	




ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24710	
Description:	Asbestos: Strongly Presumed D229-00-2/414: Yard - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable: Sheath	
Comments:	3m Visible x 20mmØ white braided cable from box on mezzanine gate	
Reference:	24801	
Description:	Asbestos: No Access: Presumed D229-00-2/419/FLR-01: Floor - 1 - Toilet - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Void	
Comments:	Beneath Inspection Chamber	
Reference:	24807	
Description:	Asbestos: No Access: Presumed D229-00-2/661: Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable Duct: Other	
Comments:	10 x Sealed Cable Ducts	



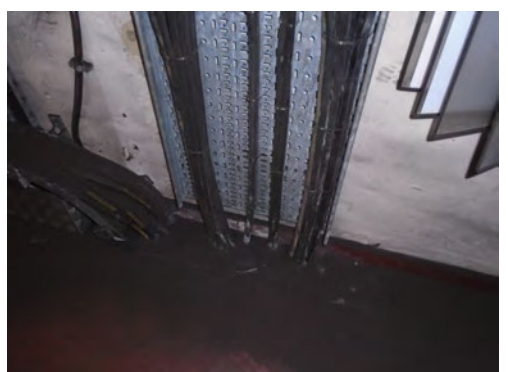
ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24805	
Description:	Asbestos: Presumed D229-00-2/661/WAL-002: Wall: Internal - 2 - Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Other Electrical Boxes	
Comments:	Automatic change over box	
Reference:	24679	
Description:	Asbestos: Strongly Presumed D229-00-2/661/WAL-002: Wall: Internal - 2 - Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Isolator Switches	
Comments:	Switch boxes Insulation within 4 x 60amp, 2 x30amp	
Reference:	24808	
Description:	Asbestos: Strongly Presumed D229-00-2/661/WAL-004: Wall: Internal - 4 - Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Isolator Switches	
Comments:	Switch boxes Insulation within - 2x 60amp	

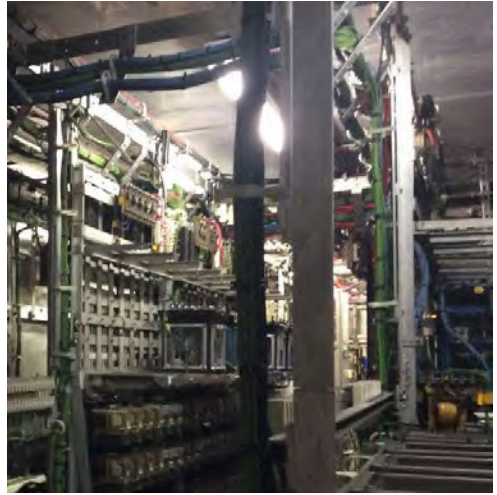
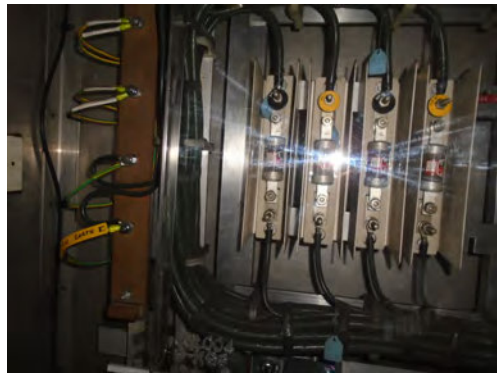
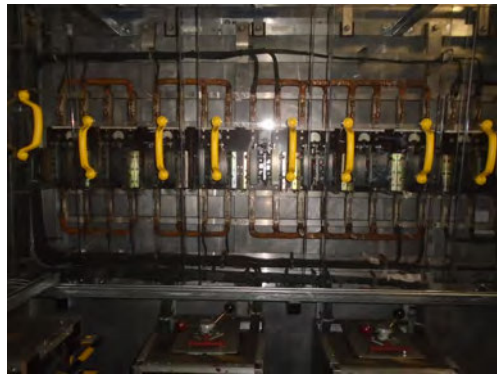
ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24810	
Description:	Asbestos: Presumed D229-00-2/662/WAL-001: Wall: Internal - 1 - Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Other Electrical Boxes	
Comments:	1 x Transformer Box on floor	
Reference:	25392	
Description:	Asbestos: Presumed D229-00-2/662/WAL-002: Wall: Internal - 2 - Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Other Electrical Boxes	
Comments:	1x 8KVA transformer on the floor wall 2 and 3	
Reference:	44289	
Description:	Asbestos: Presumed D229-00-2/663: Switch Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Cable Duct: Other	
Comments:	Floor ducts 3 no to floor under MCB box B	




ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24813	
Description:	Asbestos: No Access: Presumed D229-00-2/711/CLG-01: Ceiling: Solid - 1 - IMR - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Void	
Comments:	No Access behind Metal Cladding	
Reference:	24818	
Description:	Asbestos: Strongly Presumed D229-00-2/712: Relay Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Other Electrical Boxes	
Comments:	Flashguards	
Reference:	24816	
Description:	Asbestos: Presumed D229-00-2/712: Relay Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Other Boarding	
Comments:	Various Paxoline Boards throughout room	



ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24817	
Description:	Asbestos: Presumed D229-00-2/712: Relay Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Other Electrical Boxes	
Comments:	2 x Circuit Breakers	
Reference:	24814	
Description:	Asbestos: No Access: Presumed D229-00-2/712/CLG-01: Ceiling: Solid - 1 - Relay Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Void	
Comments:	No access behind Metal Cladding	
Reference:	24815	
Description:	Asbestos: Strongly Presumed D229-00-2/712/WAL-001: Wall: Internal - 1 - Relay Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Westing house Boxes	
Comments:	Westinghouse Joint Boxes	


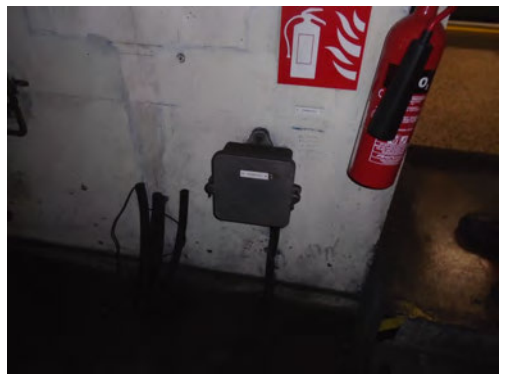
ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	25469	
Description:	Asbestos: Strongly Presumed D229-00-2/712/WAL-003: Wall: Internal - 3 - Relay Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Westing house Boxes	
Comments:	Westinghouse Joint Boxes	
Reference:	24903	
Description:	Asbestos: No Access: Presumed D229-00-2/731/CLG-01: Ceiling: Solid - 1 - CER - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Void	
Comments:	No Access behind Metal Cladding	

ITEMS TO BEWARE OF

The following items are known to be in the locations of your works noted within section 1.2, these items should remain undisturbed during the works described in section 1.4, however if you do need to disturb any of these items please contact the Hazardous Materials Unit for further advice and guidance:

Reference:	24904	
Description:	Asbestos: Strongly Presumed D229-00-2/731/WAL-003: Wall: Internal - 3 - CER - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Isolator Switches	
Comments:	Switch Boxes - Insulation within 2 x 60amp	
Reference:	24681	
Description:	Asbestos: Presumed D229-00-2/771/WAL-004: Wall: Internal - 4 - Pump Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Other Electrical Boxes	
Comments:	1x Tencore box	
Reference:	24912	
Description:	Asbestos: Known D229-00-A/776: Fan Room - Station Building - Hatton Cross Stn Start(m): Not Specified Finish(m): Not Specified	
Hazard Area:	Rope Gaskets	
Comments:	Gaskets to Vent Equipment - Chrysotile	