



7WAY TP&N
Ryfield Distribution
board
OFFICE MAINS INTAKE

95mm x 4core
singles + 50mm

TP&N 200A
Intake Head

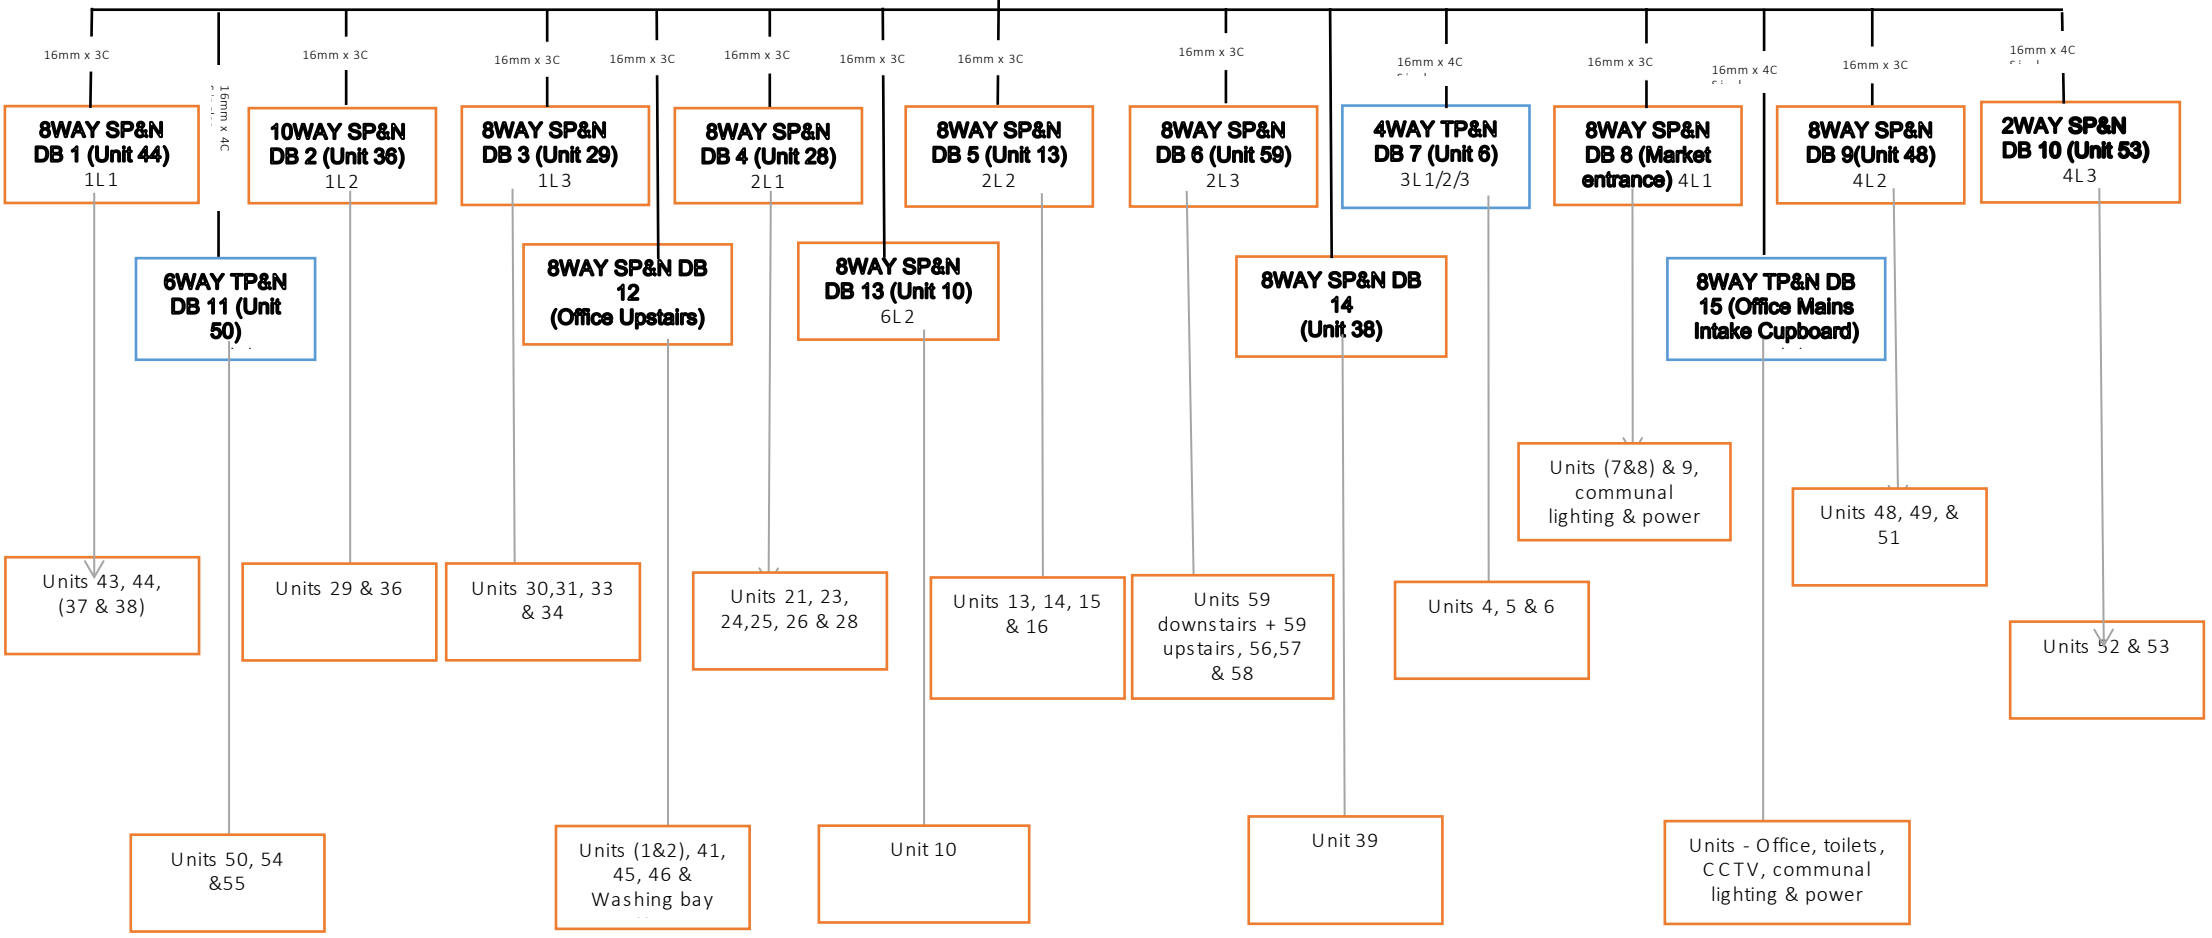


DB-1/1L1

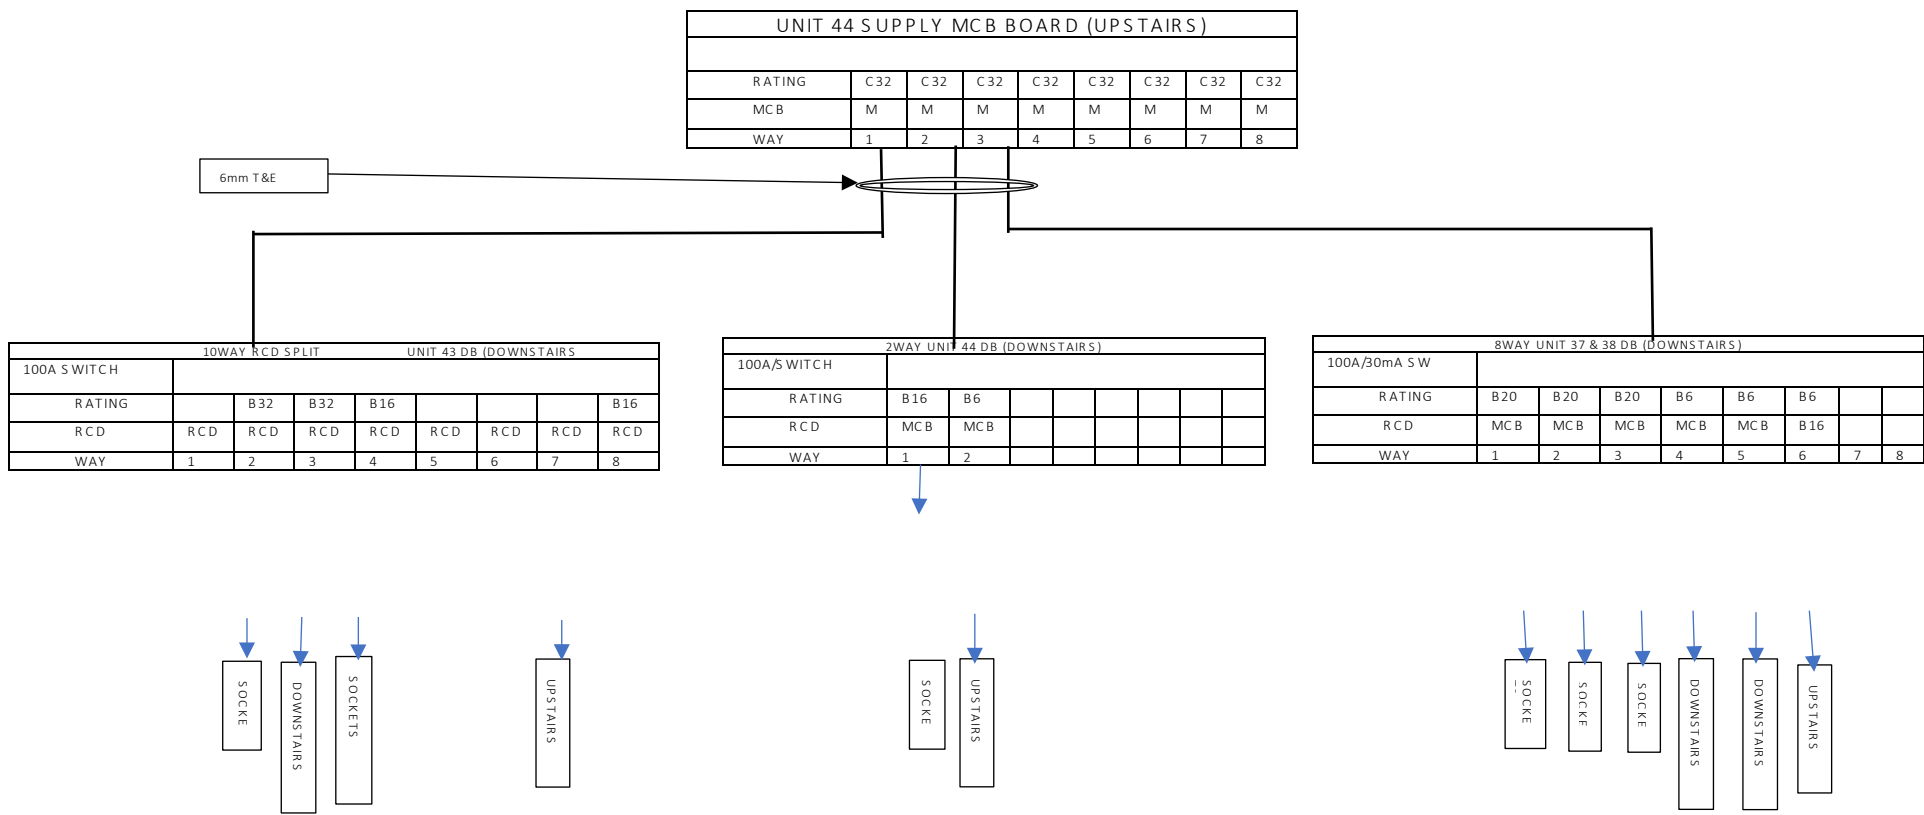


DB-2/1L2

16mm x 2core swa from office MEM 3PH DB

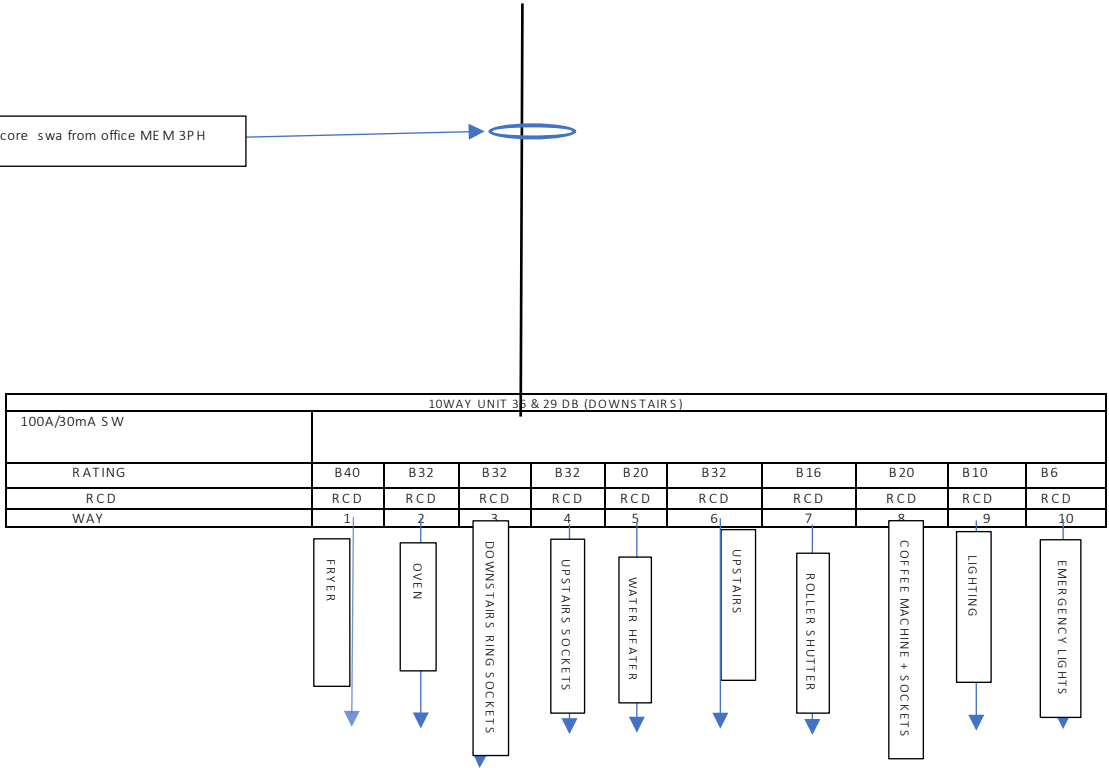

DB-3/1L3

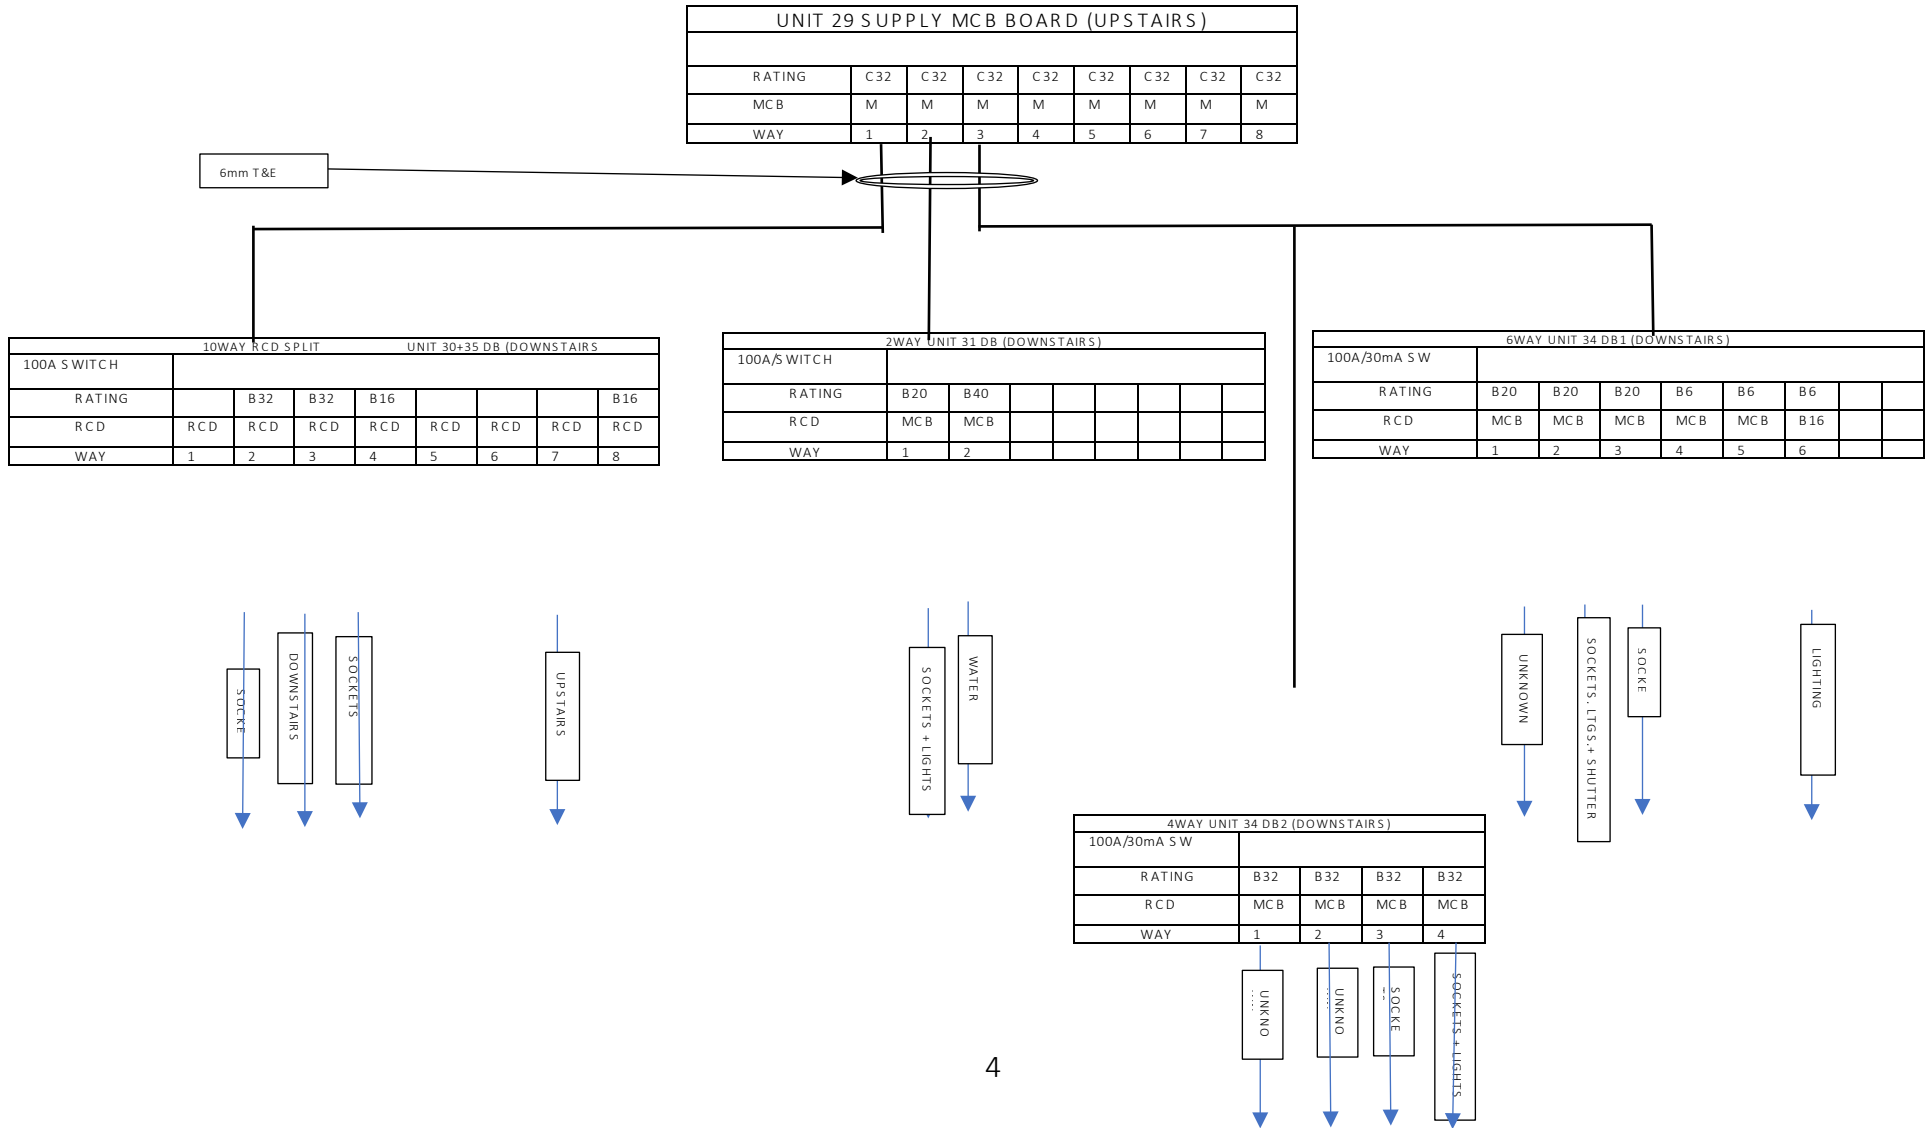


DB-4/2L1


UNIT 28 SUPPLY MCB BOARD (UPSTAIRS)								
RATING	C32	C32	C32	C32	C32	C32	C32	C32
MCB	M	M	M	M	M	M	M	M
WAY	1	2	3	4	5	6	7	8

6mm T&E


8WAY RCD SPLIT UNIT 27+28 DB (DOWNSTAIRS)								
100A SWITCH	B6	B6	B16	B32				
RCD	RCD	RCD	RCD	RCD	RCD	RCD	RCD	RCD
WAY	1	2	3	4	5	6	7	8




3WAY UNIT 21+22 DB (DOWNSTAIRS)			
100A/30mA SWITCH	B6	B32	B32
RCD	RCD	RCD	RCD
WAY	1	2	3

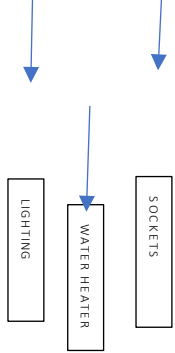


4WAY UNIT 23 DB (DOWNSTAIRS)				
100A SWITCH	B20	B32	B16	B50
RCD	MCB	MCB	MCB	MCB
WAY	1	2	3	4




8WAY UNIT 25 DB (DOWNSTAIRS)								
100A/30mA S W	B20	B20	B20	B6	B6	B6		
RCD	RCD	RCD	RCD	RCD	RCD	RCD		
WAY	1	2	3	4	5	6	7	8

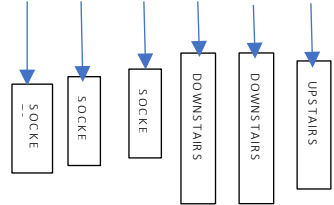

10WAY UNIT 24 DB (DOWNSTAIRS)							
100A/30mA SWITCH	B40	B32	B32	B32	B16	B16	B6
RCD	RCD	RC	RC	RC	RC	RC	RC
WAY	1	2	3	4	5	6	7

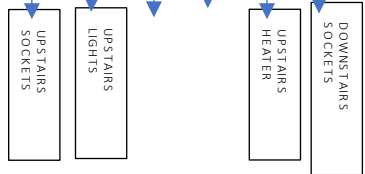

6WAY UNIT 26 DB (DOWNSTAIRS)						
100A/30mA SWITCH	B40	B32	B32	B32	B16	B6
RCD	RCD	RC	RC	RC	RC	RC
WAY	1	2	3	4	5	6

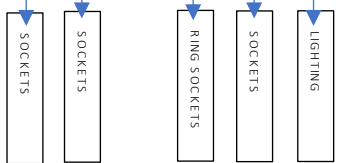

DB-5/2L2

SOCKETS R
DOWNSTAIRS
DOWNSTAIRS W
HEATER

SOCKETS

UNIT 13 SUPPLY MCB BOARD (UPSTAIRS)										
RATING	C32	C32	C32	C32	C32	C32	C32	C32	C32	C32
MCB	M	M	M	M	M	M	M	M	M	M
WAY	1	2	3	4	5	6	7	8	9	10

6mm T&E

6WAY RCD SPLIT UNIT 14 DB2						
[DOWNSTAIRS] 100A/30mA SWITCH						
RATING	B40	B32	B32	B16		
RCD	RCD	RCD	RCD	RCD	RCD	RCD
WAY	1	2	3	4	5	6

LIGHTING

SOCKE

SOCKETS

SOCKETS
DOWNSTAIRS

SOCKETS
DOWNSTAIRS

10WAY UNIT 15 DB3 (DOWNSTAIRS)				
100A SWITCH				
RATING	B6	B6	B40	B16
MCB	MCB	MCB	MCB	MCB
WAY	1	2	3	6

SOCKETS

UNKNOWN

SOCKETS

UNKNOWN

4WAY UNIT 13 DB4 (DOWNSTAIRS)			
45A SWITCH			
RATING	B32	B32	
MCB	MCB	MCB	MCB
WAY	1	2	4

LIGHTING

SOCKETS

2WAY UNIT 15 DB5 (DOWNSTAIRS)		
63A SWITCH		
RATING	B40	B20
MCB	MCB	MCB
WAY	1	2

SOCKE

DOWNSTAIRS

2WAY UNIT 15 DB6 (DOWNSTAIRS)	
63A SWITCH	
RATING	B32 B20
MCB	MCB MCB
WAY	1 2

DOWNSTAIRS
SOCKETS

DOWNSTAIRS

10WAY UNIT 15 DB7 (DOWNSTAIRS)							
100A/30mA SWITCH							
RATING	B32	B32	B40	B32	B32	B32	B6
RCD	RCD	RCD	RCD	RCD	RCD	RCD	RCD
WAY	1	2	3	6	7	8	9

SOCKETS

SOCKETS

WATER HEATER

SOCKETS


SOCKETS


SOCKETS

LIGHTING


UNIT 16 DB8 (DOWNSTAIRS) NOT ACCESSIBLE			
UNKNOWN			
RATING			
RCD/MCB			
WAY	1	2	4

DB-6/2L3

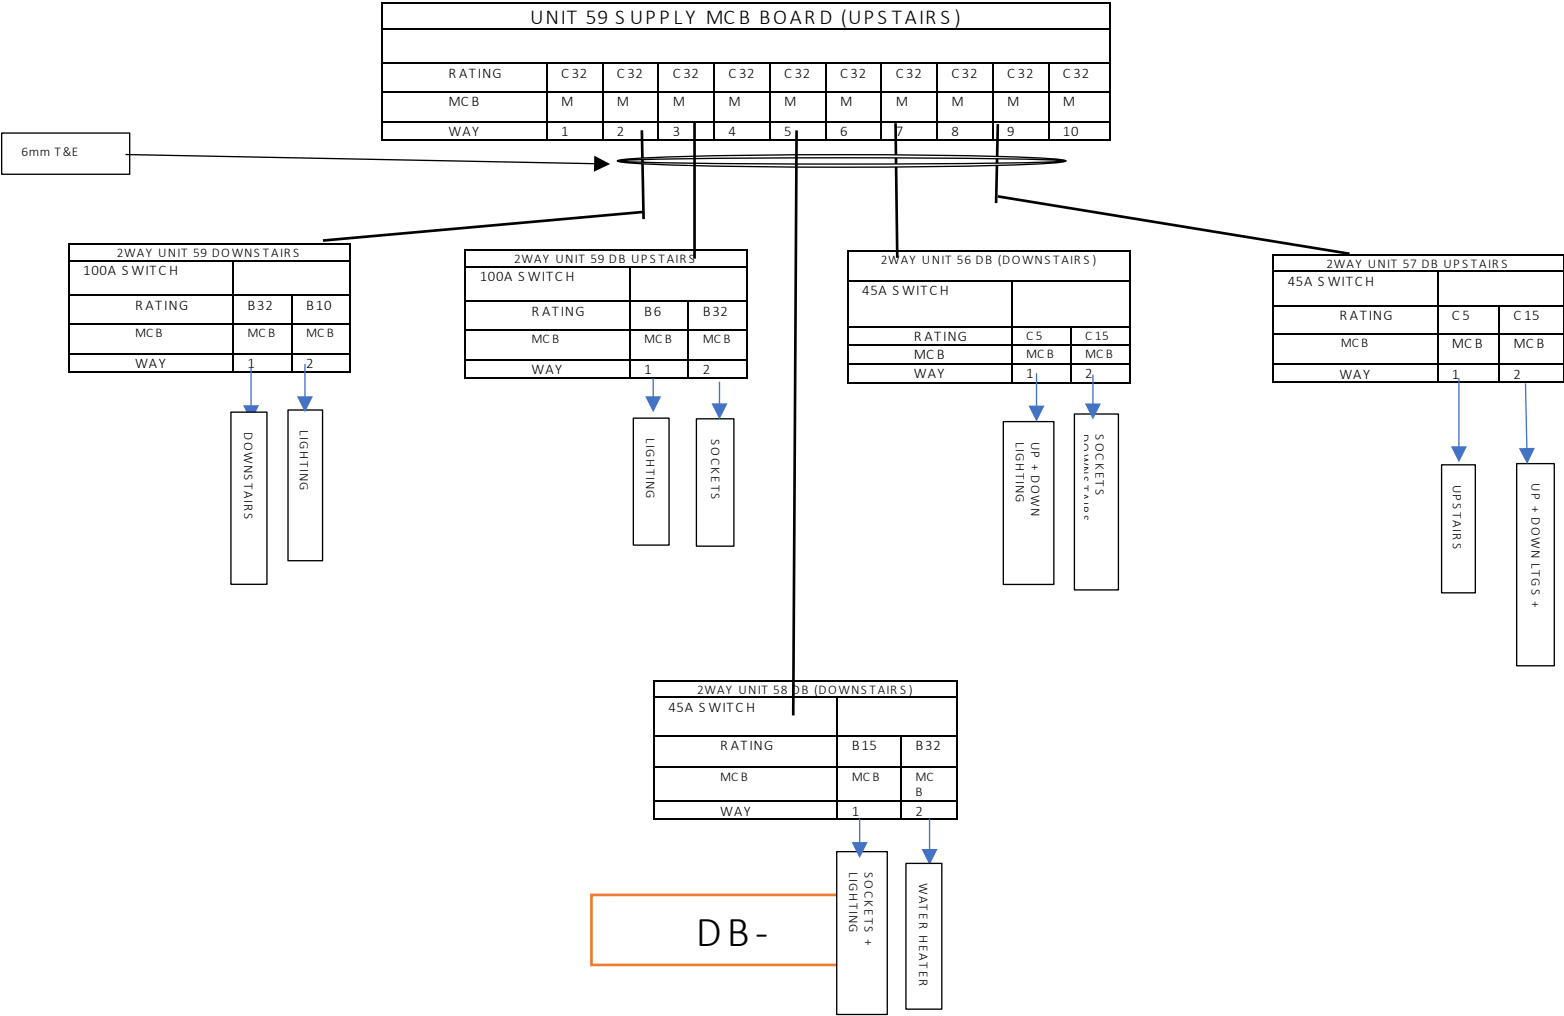


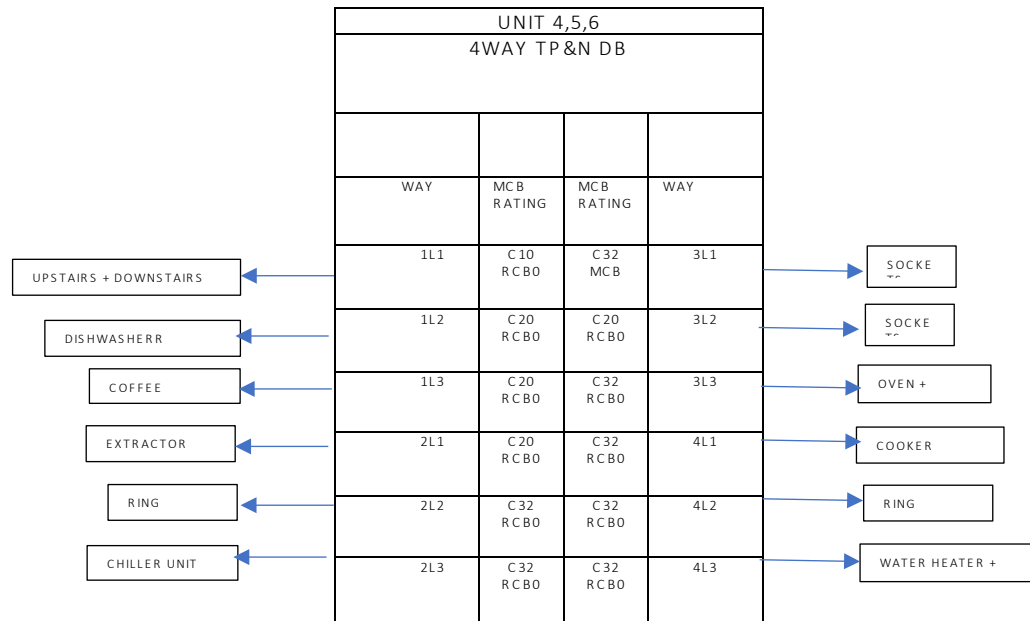

DB-8/4L1

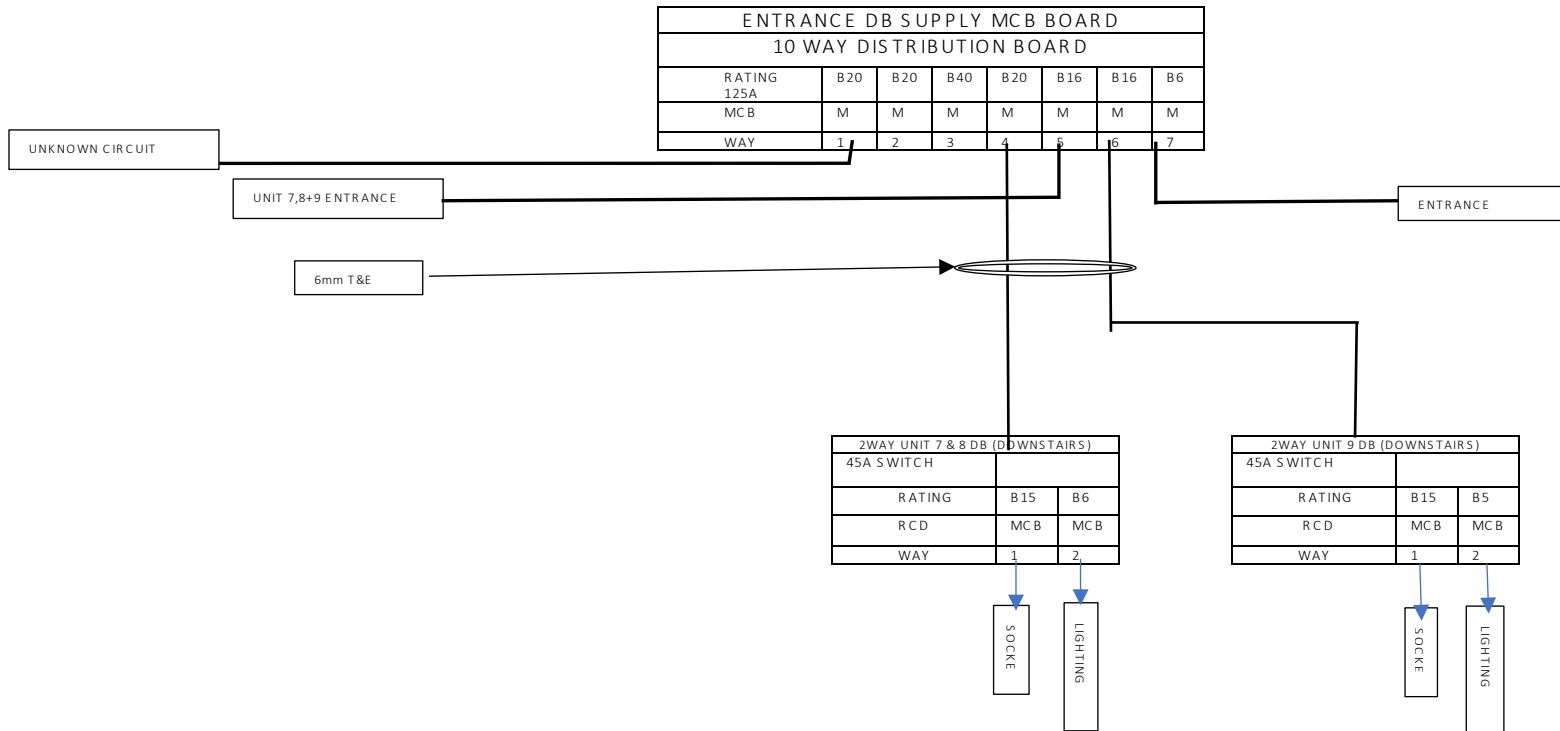


DB-9/4L2

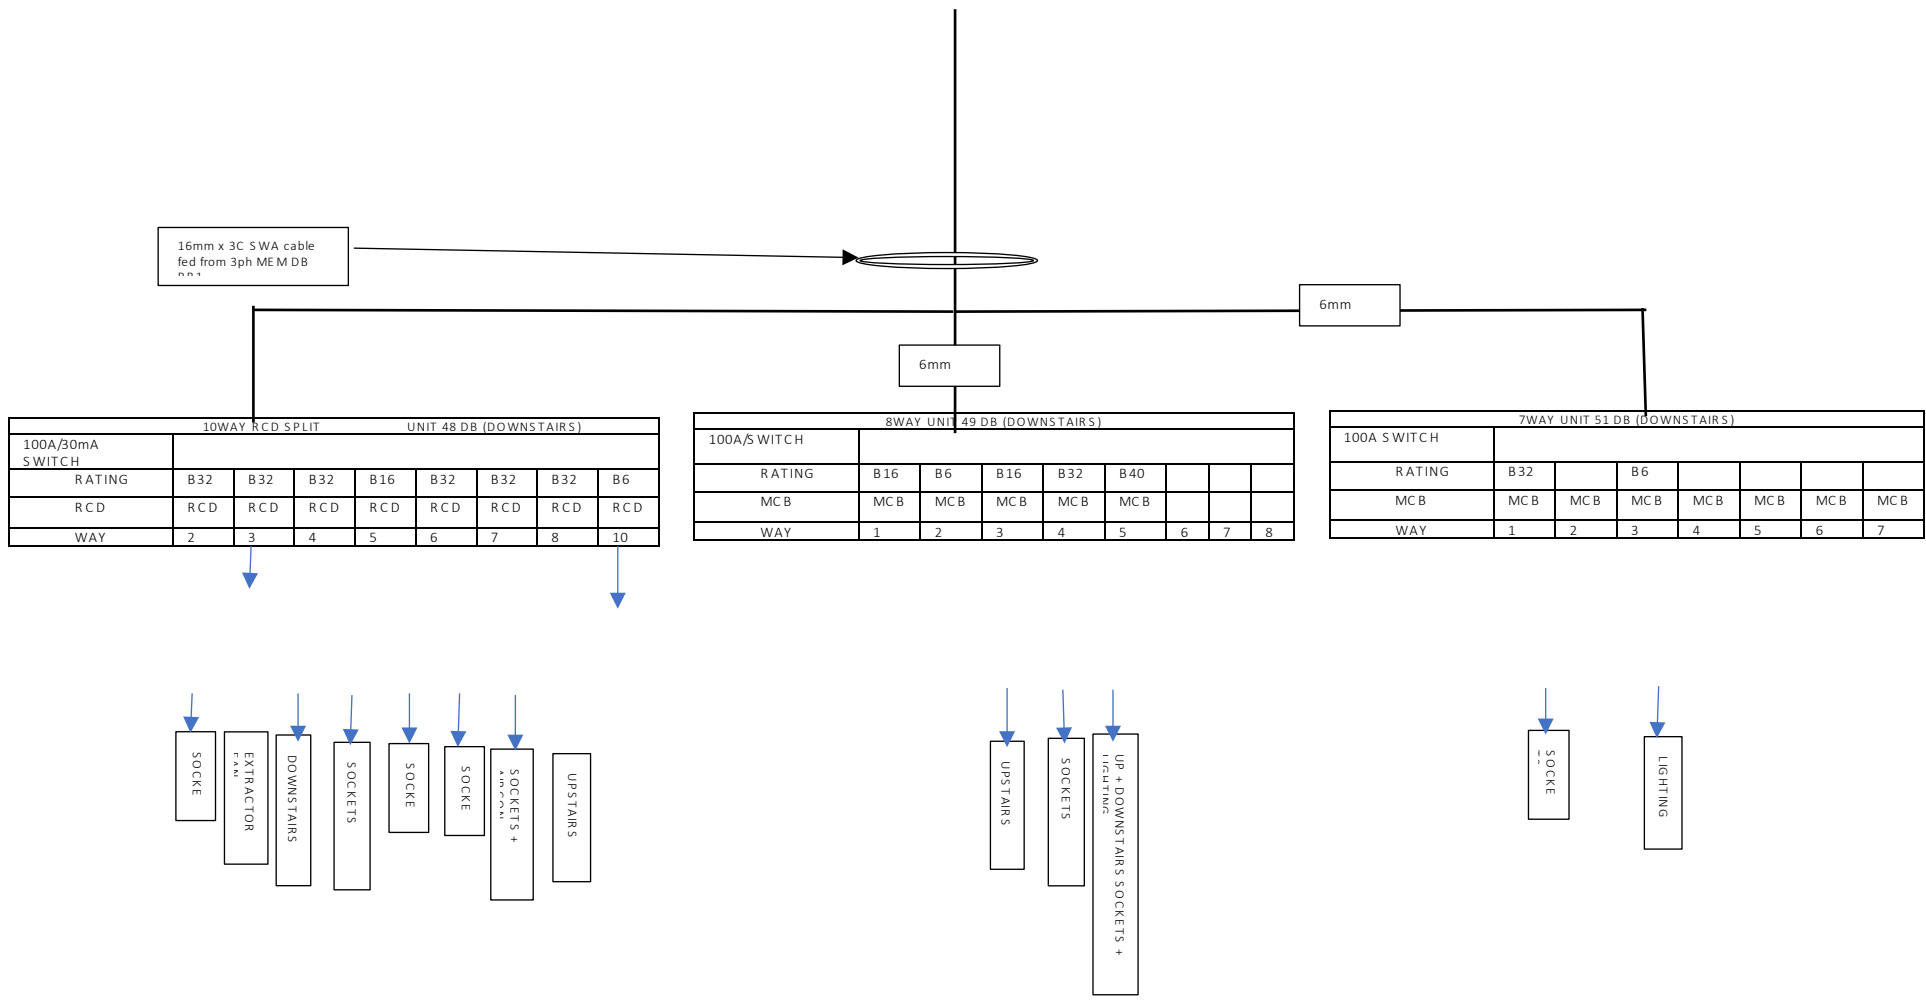


XXX

DB-

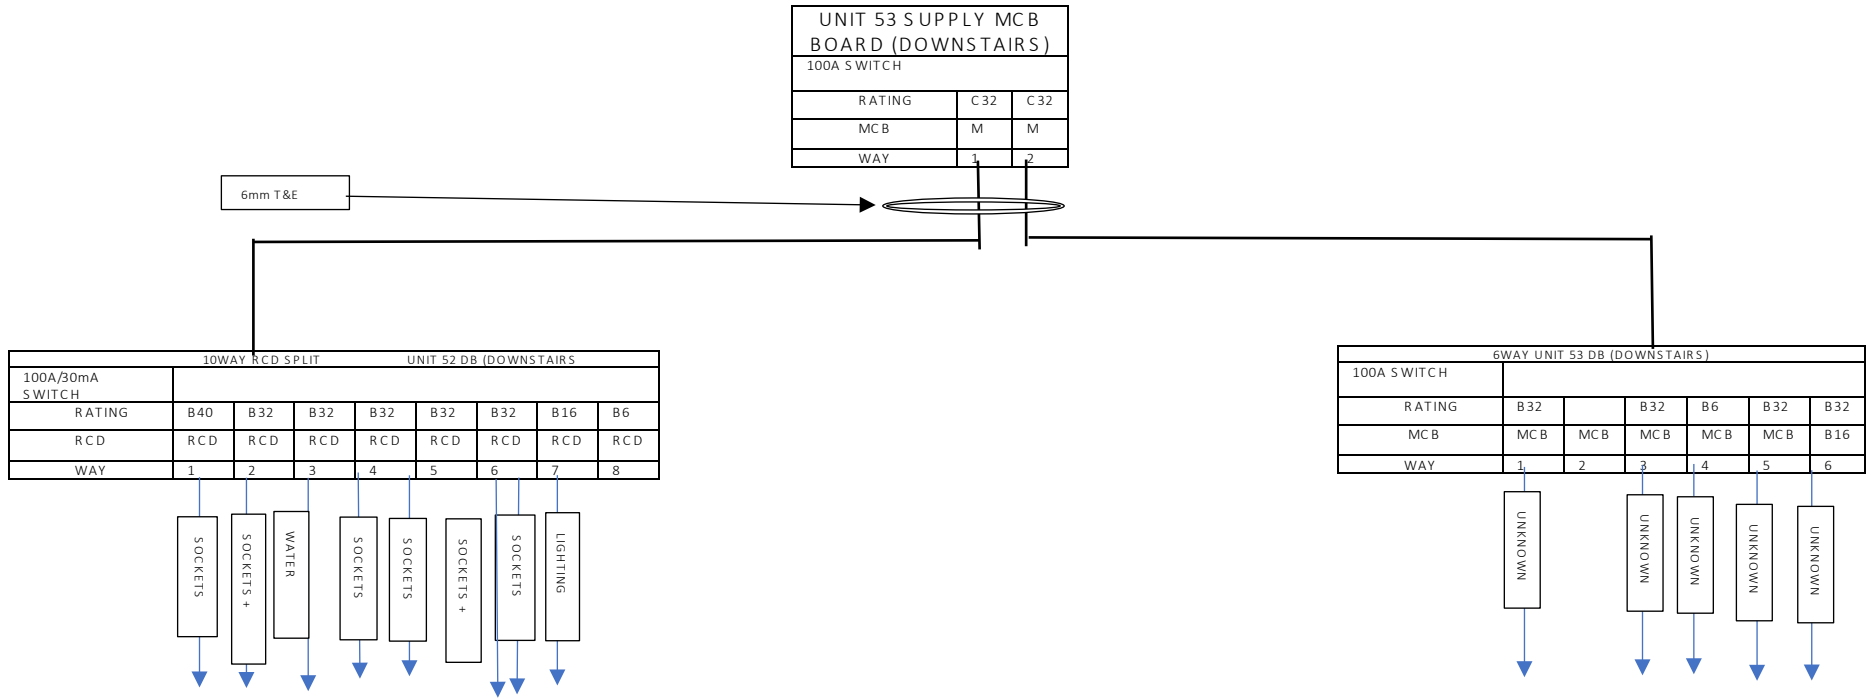


DB-11/5L1/2/3

XXX

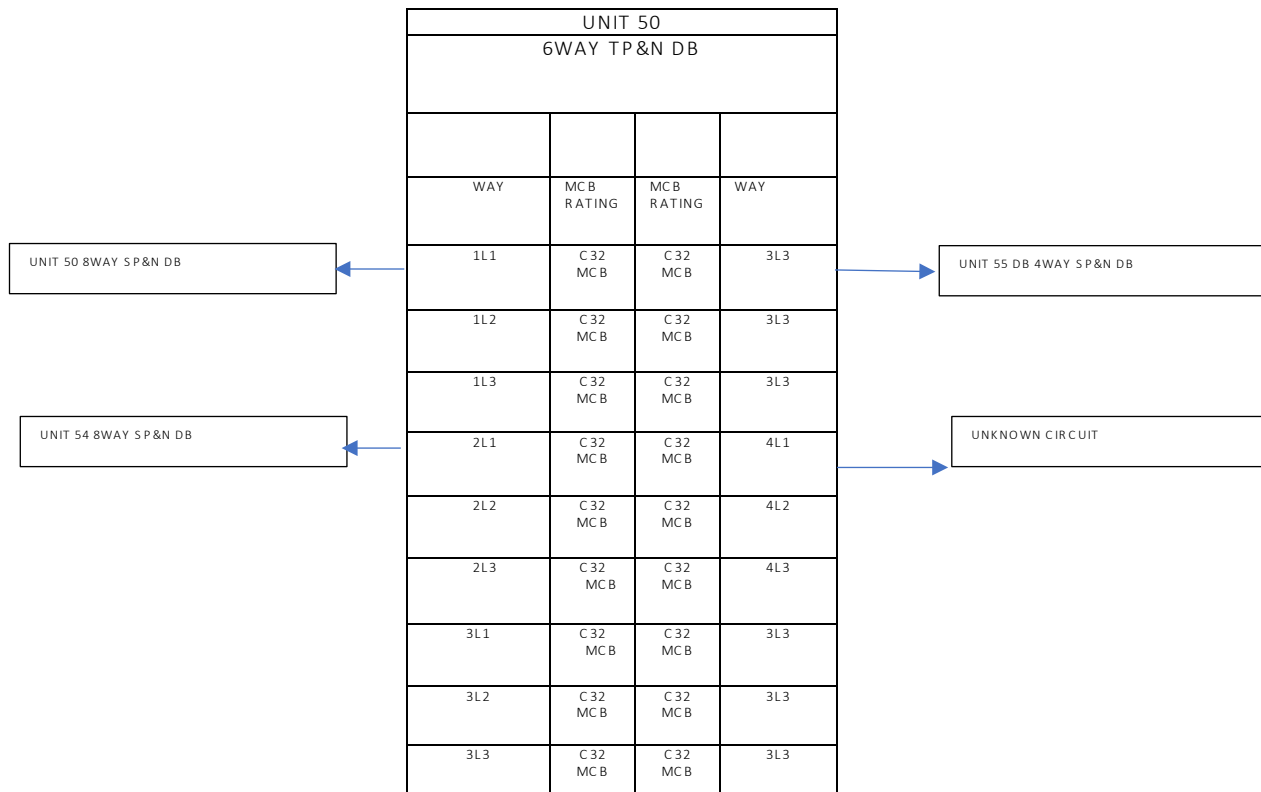


DB-12/6L1

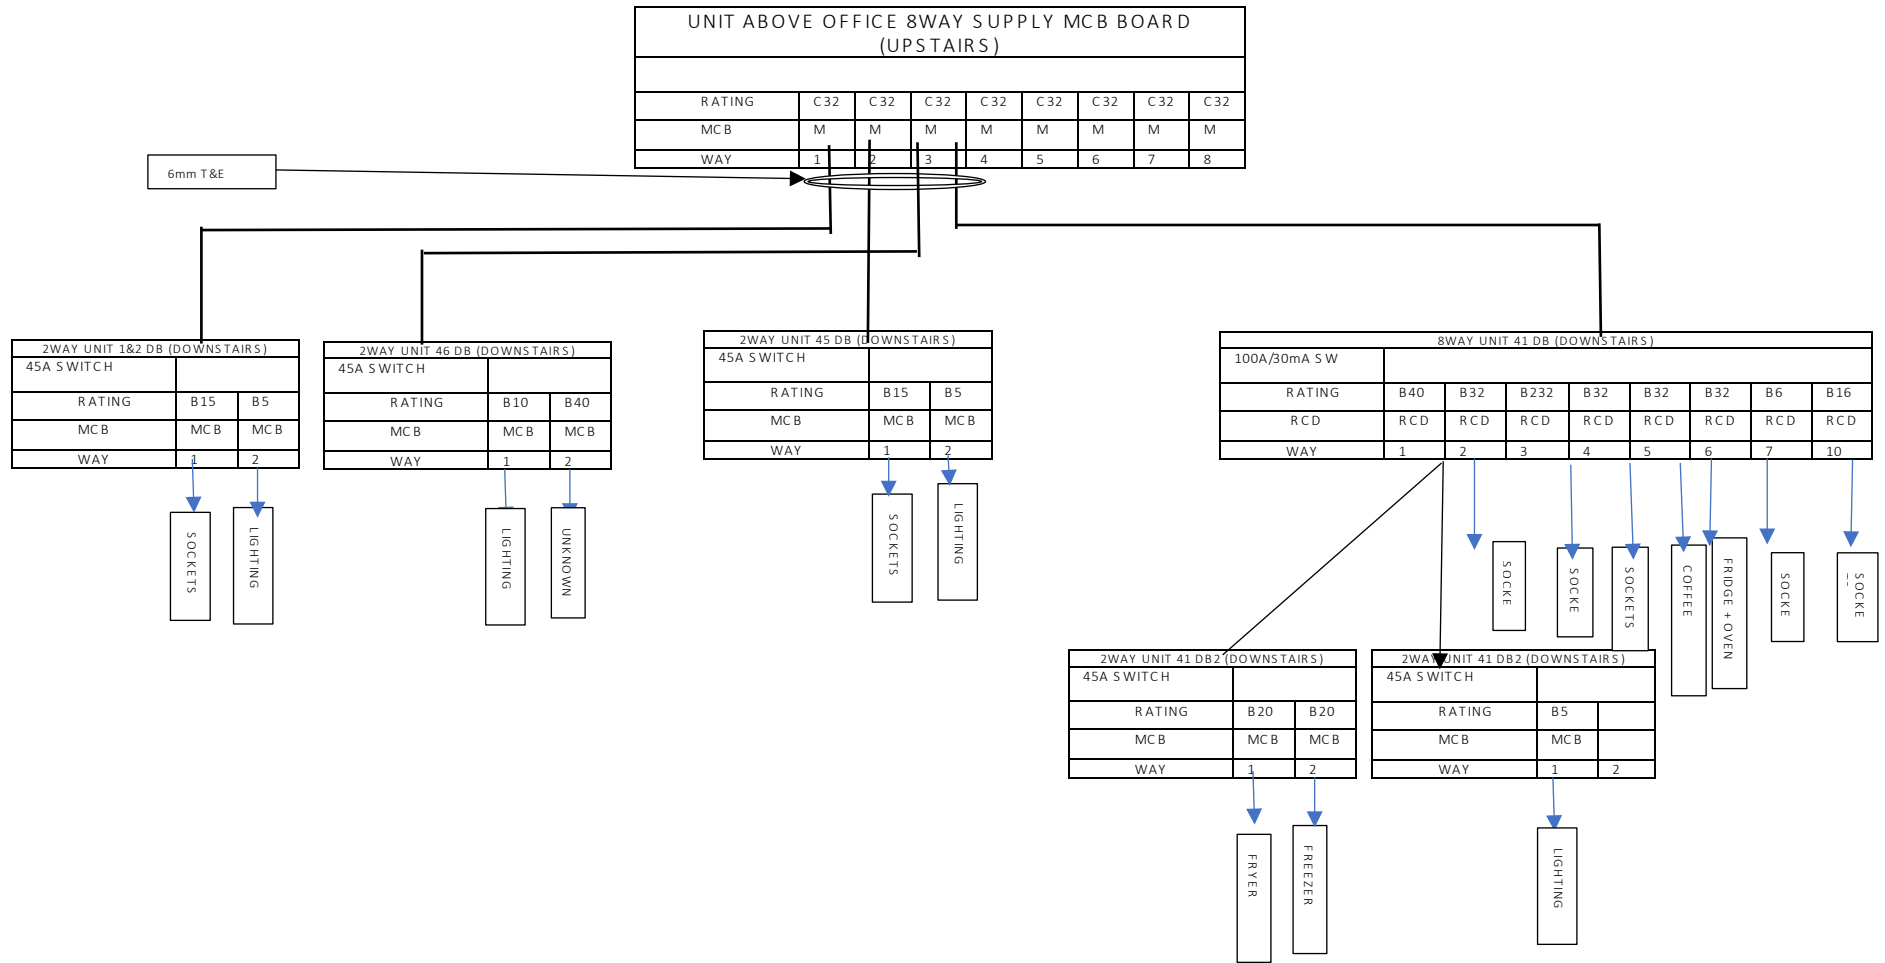


DB-13/6L2-UNIT
10

16mm x 4c SWA fed from MEM 3PHAS E DB

UNIT 10 MCB BOARD (UPSTAIRS)								
100A/30mA RCD								
RATING	C32	C32						B6
MCB	M	M	M	M	M	M	M	M
WAY	1	2	3	4	5	6	7	8

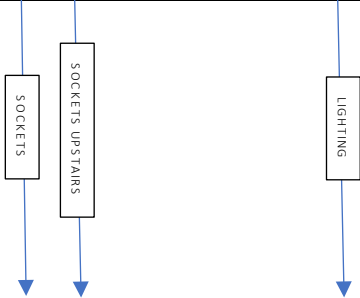

DB-14/1L1/UNIT

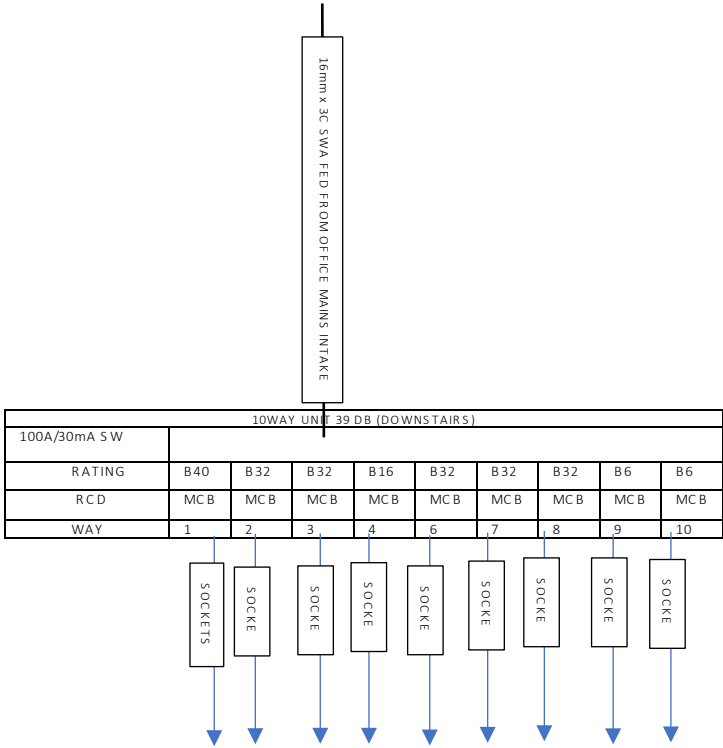

DB-

OFFICE			
8WAY TP&N DB1- Communal Lighting + Power			
WAY	MCB RATING	MCB RATING	WAY
1L1	C10 RCBO	C32 MCB	5L1
1L2	C10 RCBO	C20 RCBO	5L2
1L3	C16 RCBO	C32 RCBO	5L3
2L1	C16 RCBO	C32 RCBO	6L1
2L2	C32 RCBO	C32 RCBO	6L2
2L3	C32 RCBO	C32 RCBO	6L3
3L1	C32 MCB	C32 MCB	7L1
3L2	C32 MCB	C32 MCB	7L2
3L3	C32 MCB	C32 MCB	7L3
4L1	C32 MCB	C32 MCB	8L1
4L2	C32 MCB	C32 MCB	8L2
4L3	C32 MCB	C32 MCB	8L3